



Installation in connection with flammable materials

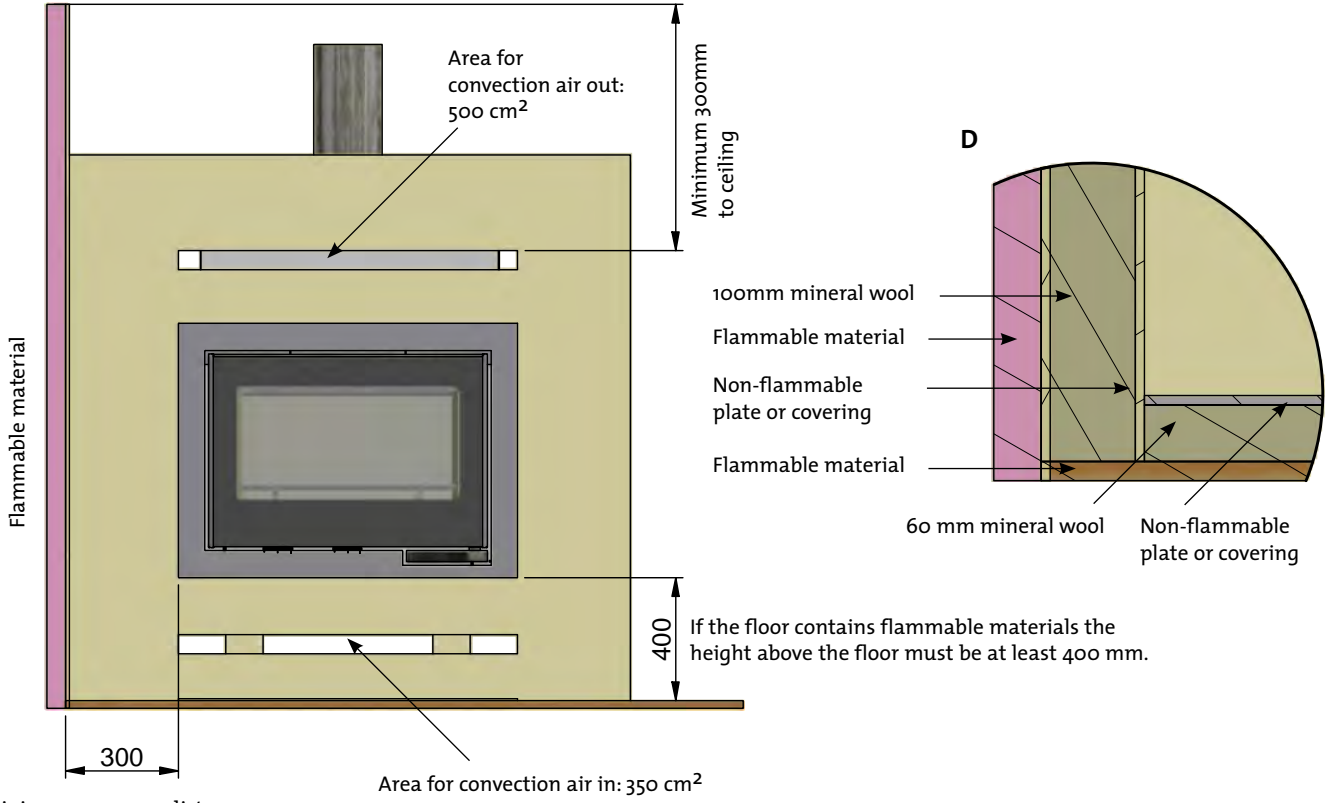

Minimum 300 mm distance to flammable materials
 Minimum 120 mm distance to non-flammable materials

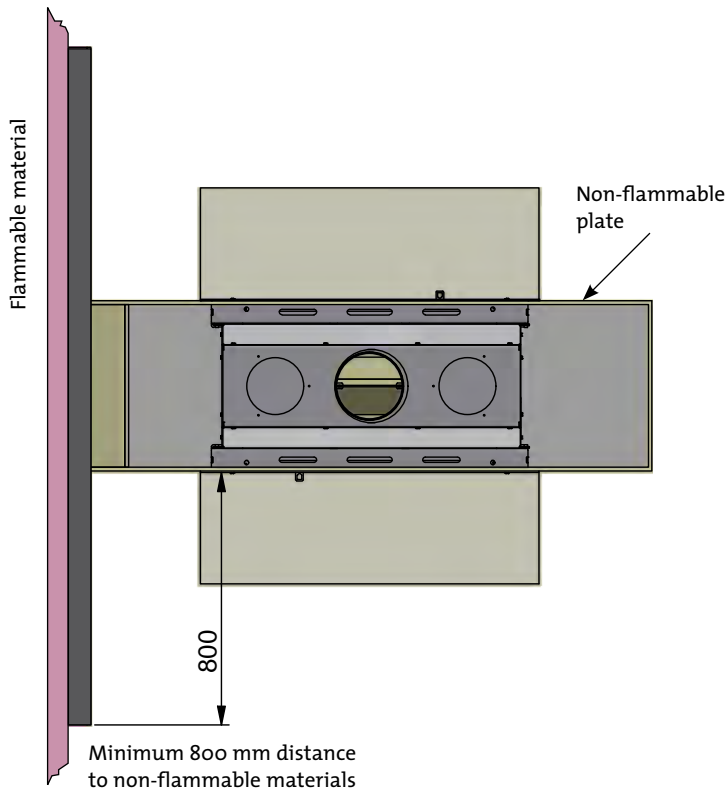

A-A

